

## EXCLUSIVE FEATURES:

- ONLY ONE SEALING LOCKNUT IS REQUIRED TO MAKE A WATERTIGHT OR RAIN-TIGHT GROUNDED CONDUIT CONNECTION.
- SAVES INSTALLATION TIME.
- SUITABLE FOR USE IN WET LOCATIONS.

**WARRANTY:** Thomas & Betts sells this product with the understanding that the user will perform all necessary tests to determine the suitability of this product for the user's intended application. Thomas & Betts warrants that this product will be free from defects in materials and workmanship for a period of two (2) years following the date of purchase. Upon prompt notification of any warranted defect, Thomas & Betts will, at its option, repair or replace the defective product or refund the purchase price. Proof of purchase is required. Misuse or unauthorized modification of the product voids all warranties.

Limitations and Exclusions: **THE ABOVE WARRANTY IS THE SOLE WARRANTY CONCERNING THIS PRODUCT, AND IS IN LIEU OF ALL OTHER WARRANTIES EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, WHICH ARE SPECIFICALLY DISCLAIMED. LIABILITY FOR BREACH OF THE ABOVE WARRANTY IS LIMITED TO COST OF REPAIR OR REPLACEMENT OF THE PRODUCT, AND UNDER NO CIRCUMSTANCES WILL THOMAS & BETTS BE LIABLE FOR ANY INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES.**

Thomas & Betts Corporation • Memphis, Tennessee • [www.tnb.com](http://www.tnb.com)


# Thomas & Betts

## SEALING LOCKNUT

### Installation Guide

Catalog Numbers

141SL, 142SL, 143SL, 144SL, 145SL, & 146SL

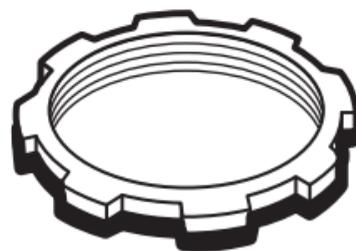

THIS GUIDE HAS BEEN PREPARED TO SHOW THE PROPER METHOD OF INSTALLING THOMAS & BETTS SEALING LOCKNUTS.

UL and CSA Certified.  
ZINC PLATED STEEL LOCKNUT  
ELASTOMER GASKET

CATALOG NUMBER	CONDUIT SIZE
141SL	1/2"
142SL	3/4"
143SL	1"
144SL	1-1/4"
145SL	1-1/2"
146SL	2"

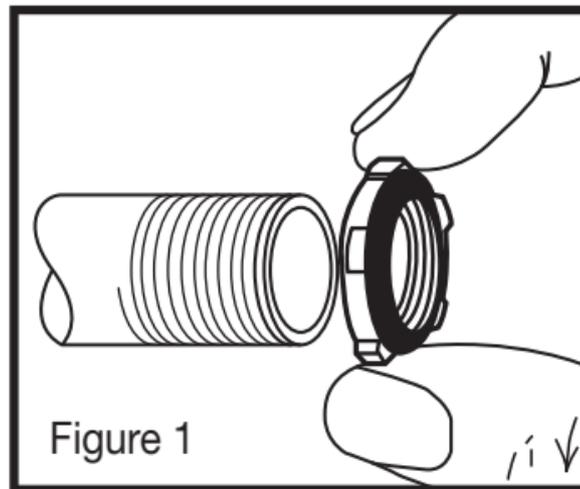


Figure 1

1. Thread sealing locknut onto conduit up to end of thread, as shown in Figure 1.

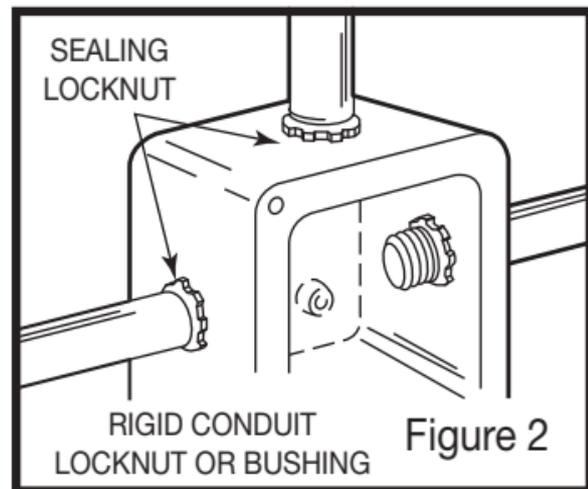


Figure 2

2. Insert conduit into entry at enclosure with sealing locknut on outside as shown in Figure 2.
3. Install rigid conduit locknut or bushing on inside and tighten assembly for secure seal and ground.