

INSTALLATION INSTRUCTIONS FLUSH-FLOOR POKE-THROUGH FITTING FOR FURNITURE FEED


Cat. No. FPT448

⚠ WARNING ⚠
ELECTRICAL HAZARD!
BE SURE POWER IS OFF!


IMPORTANT NOTES:

1. This flush POKE-THROUGH system is designed to maintain the hourly rating of concrete floors having ratings of 1 to 4 hours, when installed in accordance with these installation instructions.
2. To maintain fire resistance classification rating either of the following must be installed:
 - a) A complete Thomas & Betts service fitting, including the service fitting base and service fitting cover.
 - or
 - b) An abandonment kit, Catalog No. FPT415.
3. See product category "outlet boxes and fittings" classification for fire resistance standards. This can be found in the current Underwriters Laboratories, Inc. "Fire Resistance Directory," which includes a listing for the fire resistance classification of the Thomas & Betts Modular Poke-Through System.
4. All installations of UL listed Poke-Through service fittings have the following restrictions: "Minimum of 2 ft. on center and not more than one device per 65 sq. ft. of floor area in each span."
5. This through-floor fitting will mount several types of Thomas & Betts UL listed service fittings which will accommodate different combinations of power, telephone and data. Determine location and orientation of mounting screw holes for the specific service fitting chosen prior to installation. CONSULT THE ENCLOSED ADDENDUM FOR MORE DETAILS.
6. All flush Poke-Through covers are UL Listed for scrub-water exclusion while in the closed position with gaskets installed, silicone sealant applied and thread sealer used where applicable.

INSTALLATION INSTRUCTIONS

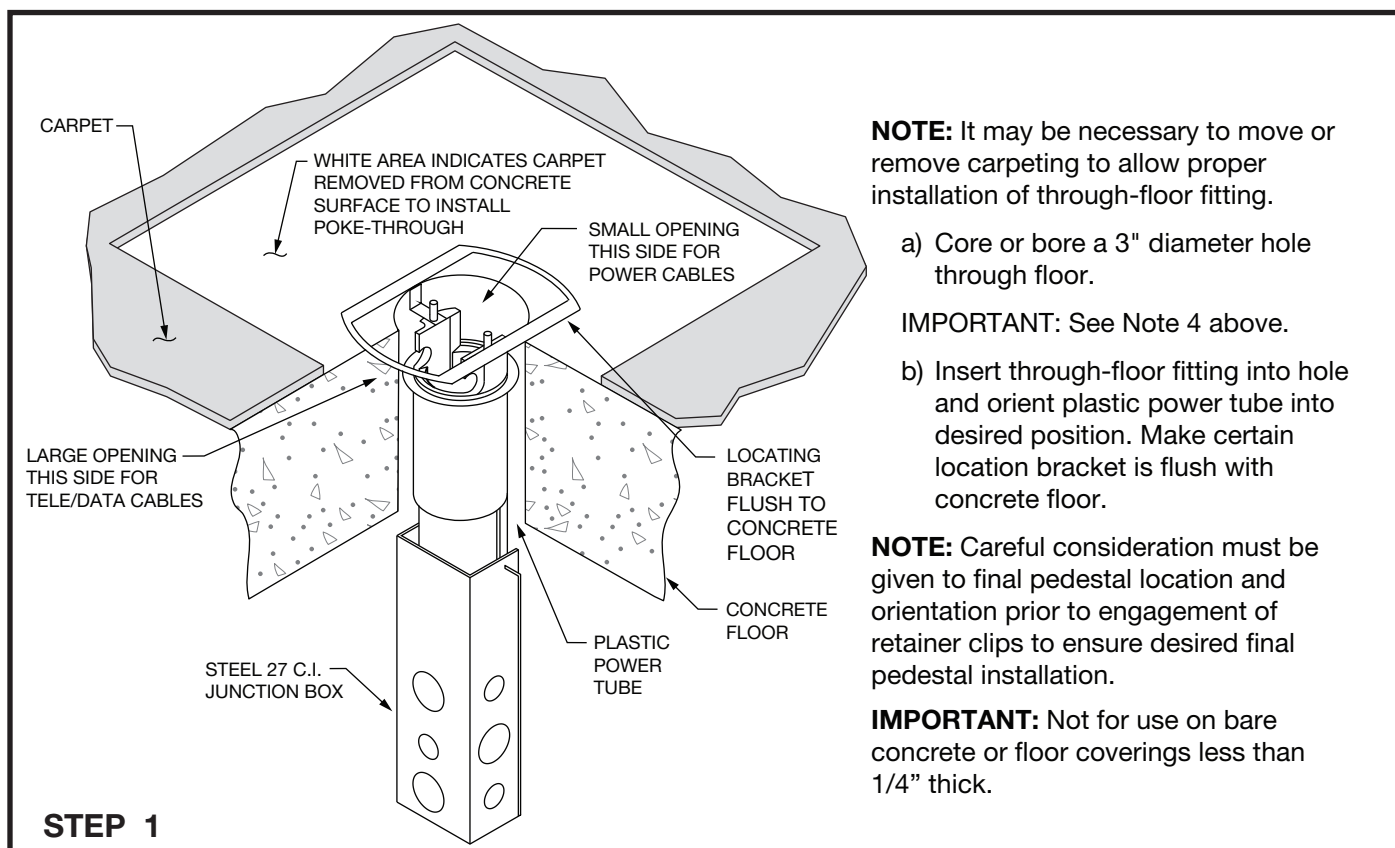


Thomas & Betts

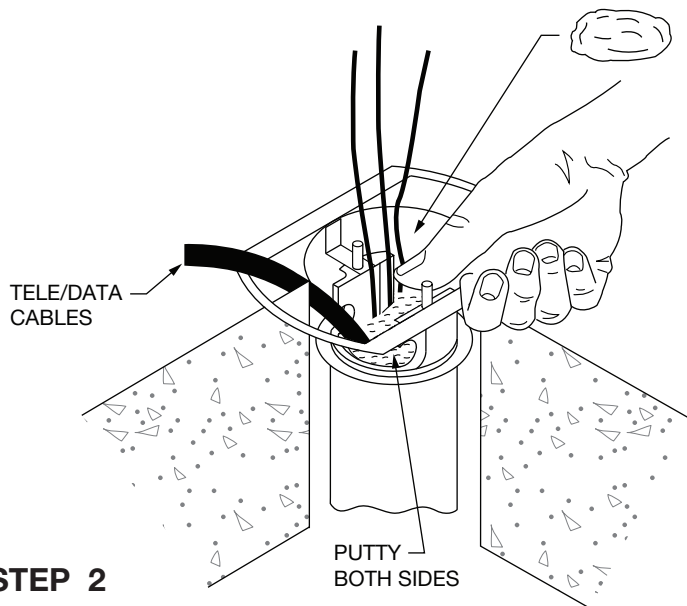


STEP 2

- Ensure that all electrical power is disconnected and that wires are de-energized. Feed power wires into power side of Poke-Through.
- Draw Tele/Data cable(s) out through top of device as shown.
- Fill inside of Poke-Through device with putty supplied. Press firmly into place around all wires. Use all putty material supplied.

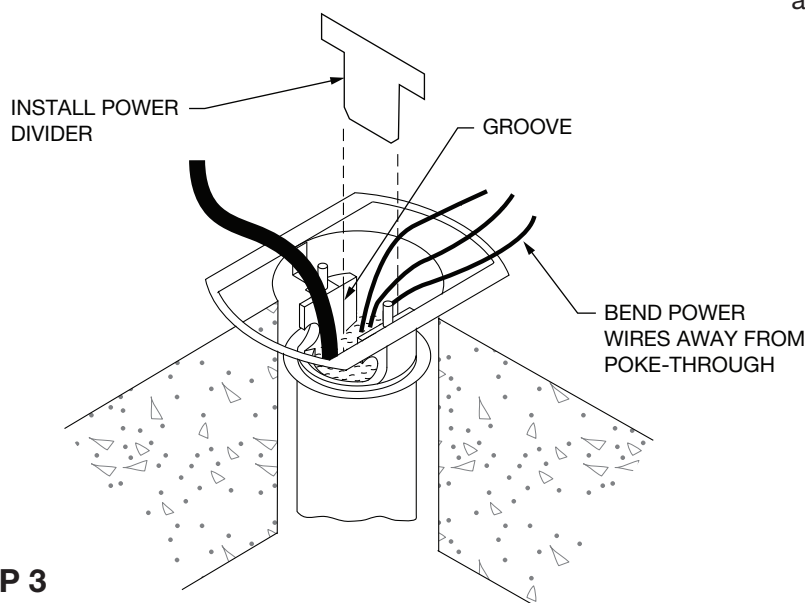

STEP 3


- Insert power divider into top of Poke-Through device by sliding tabs into grooves, slide power divider down until top of Poke-Through fits into cutout.
- NOTE:** Be sure to separate power wires from tele/data cables as shown.

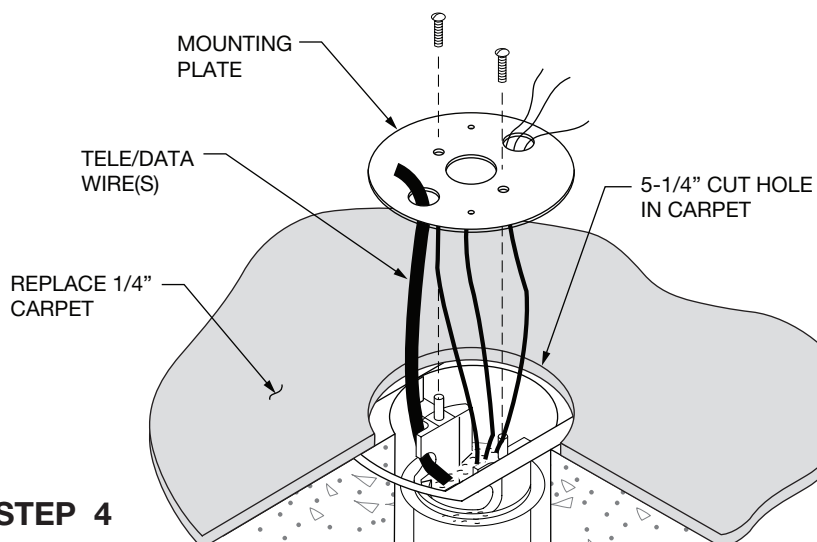

STEP 4


- Replace 1/4" thick carpet.
- Cut 5-1/4" hole in carpet over Poke-Through.
- Feed tele/data and power wire(s) into mounting plate as shown.
- Attached mounting plate to Poke-Through with screws furnished.

- a) To ensure scrub-water exclusion, apply a continuous bead of silicone sealant around mounting plate underneath base plate.
- b) Place gasket between cover and base plate, aligning holes for screws.
- c) Attach base plate to mounting plate with two flat head screws furnished, 8 lbs-in torque maximum. Make sure silicone makes a complete seal between floor and base plate.

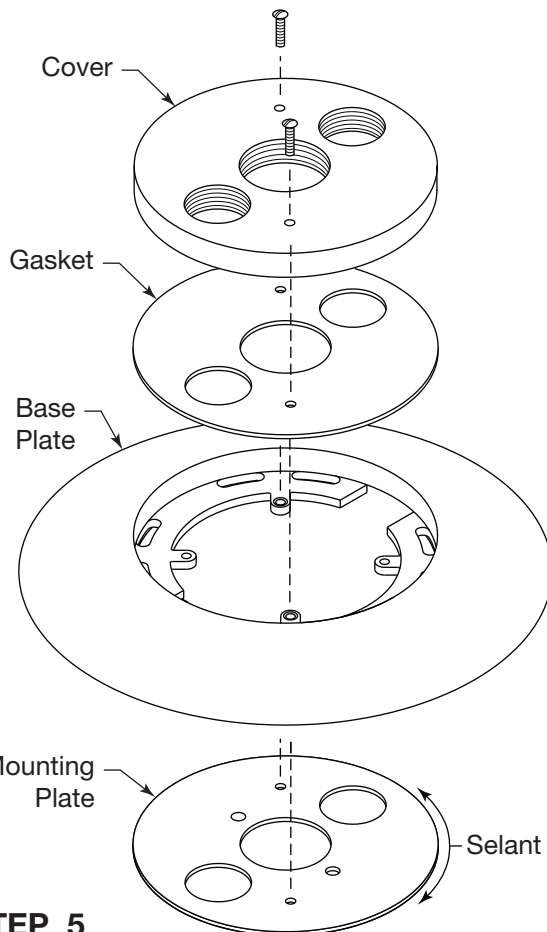

STEP 5

- a) Attach suitable fittings.
- b) All unused ports in cover are to be plugged with threaded caps
- c) Use thread sealer on all plugs and fittings for scrub-water exclusion.

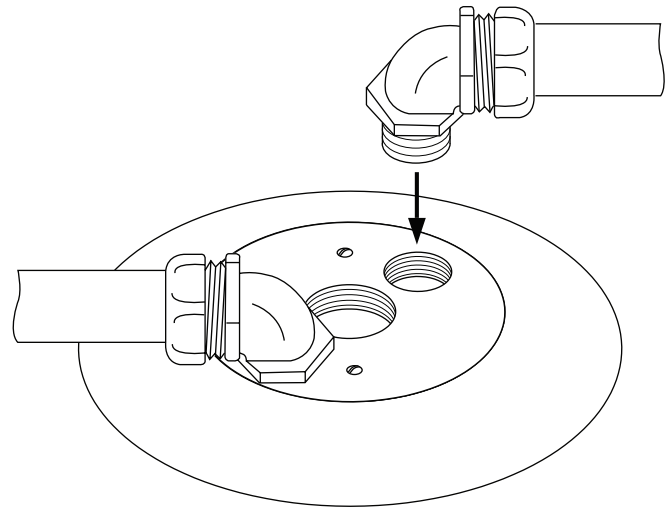

STEP 6

SEE LAST PAGE FOR REPLACEMENT INSTRUCTIONS

WARRANTY: Thomas & Betts sells this product with the understanding that the user will perform all necessary tests to determine the suitability of this product for the user's intended application. Thomas & Betts warrants that this product will be free from defects in materials and workmanship for a period of two (2) years following the date of purchase. Upon prompt notification of any warranted defect, Thomas & Betts will, at its option, repair or replace the defective product or refund the purchase price. Proof of purchase is required. Misuse or unauthorized modification of the product voids all warranties.



Limitations and Exclusions: **THE ABOVE WARRANTY IS THE SOLE WARRANTY CONCERNING THIS PRODUCT, AND IS IN LIEU OF ALL OTHER WARRANTIES EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, WHICH ARE SPECIFICALLY DISCLAIMED. LIABILITY FOR BREACH OF THE ABOVE WARRANTY IS LIMITED TO COST OF REPAIR OR REPLACEMENT OF THE PRODUCT, AND UNDER NO CIRCUMSTANCES WILL THOMAS & BETTS BE LIABLE FOR ANY INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES.**

Thomas & Betts Corporation
Memphis, Tennessee
www.tnb.com

REPLACEMENT INSTRUCTIONS FOR OTHER T&B FIRE-RATED PEDESTALS


⚠ WARNING ⚠
ELECTRICAL HAZARD!
BE SURE POWER IS OFF!

- a) Remove cover plate assembly by removing screws on top.

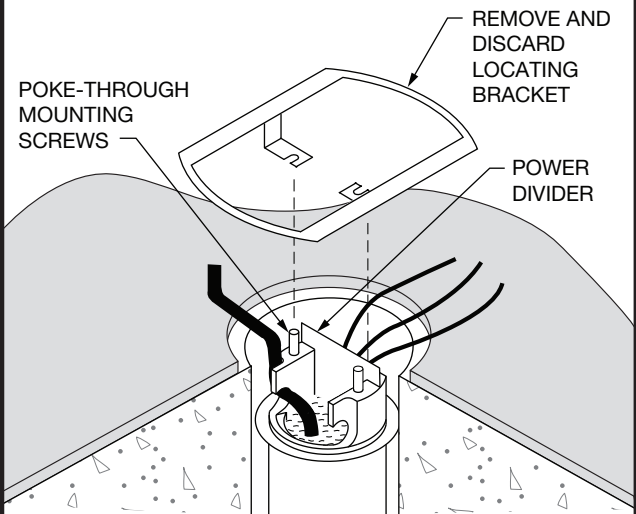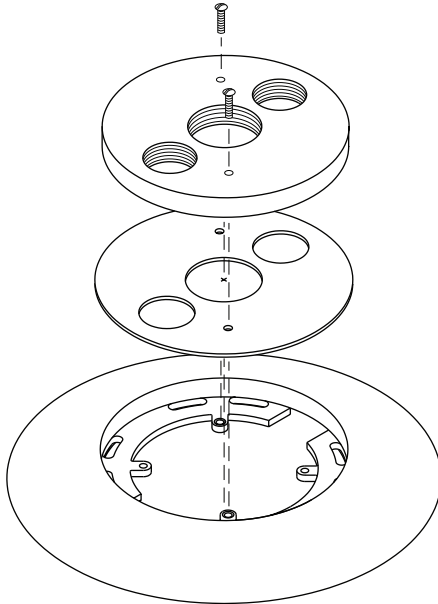

- a) Remove power divider from top of Poke-Through device.
NOTE: It may be necessary to move or remove carpeting during retrofit installation.
b) Loosen Poke-Through mounting screws 3-4 full turns.
c) Remove locating bracket by rotating clockwise and lifting out.
d) Tighten mounting screws.

STEP 2R

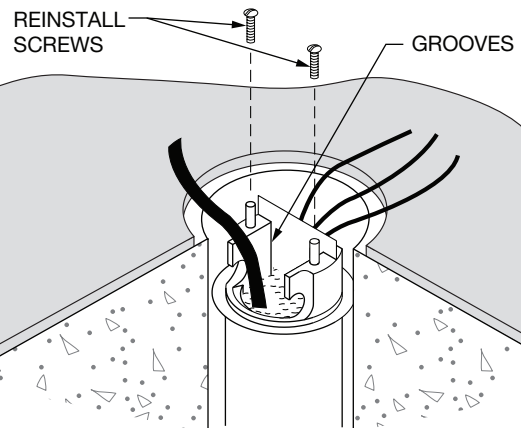

- a) Reinstall screws into Poke-Through device as shown.
b) If carpeting was removed in Step 2R, replace carpet now.
c) Install floor pedestal according to instructions supplied with pedestal.

STEP 3R

STEP 1R